

STANDARD INFORMATION

Standard Number: CSA B45.8 / IAPMO Z403

Standard Name: Terrazzo, Concrete, Composite Stone, and Natural Stone Plumbing Fixtures

Standard Edition and Issue Date: 2nd Edition Dated June 1, 2018

Date of Revision: June 1, 2018

Date of Previous Revision of Standard: September 1, 2013

EFFECTIVE DATE OF NEW/REVISED REQUIREMENTS

Effective Date: **September 23, 2019**

IMPACT, OVERVIEW, AND ACTION REQUIRED

Impact Statement: A review of all Listing Reports is necessary to determine which products comply with new/revise requirements and which products will require re-evaluation. **NOTE:** Effective immediately, this revised standard will be exclusively used for evaluation of new products unless the Applicant requests in writing that current requirements be used along with their understanding that their listings will be withdrawn on Effective Date noted above, unless the product is found to comply with new/revise requirements.

Overview of Changes:

- Overflow requirements for bathtubs was revised
- Revised requirements for the flow rate for overflow test

Specific details of new/revise requirements are found in table below.

If the applicable requirements noted in the table are not described in your report(s), these requirements will need to be confirmed as met and added to your report(s) such as markings, instructions, test results, etc. (as required).

Client Action Required:

Information – To assist our Engineer with review of your Listing Reports, please submit technical information in response to the new/revise paragraphs noted in the attached or explain why these new/revise requirements do not apply to your product (s).

Current Listings Not Active? – Please immediately identify any current Listing Reports or products that are no longer active and should be removed from our records. We will do this at no charge as long as Intertek is notified in writing prior to the review of your reports.



STANDARD INFORMATION


CLAUSE	VERDICT	COMMENT
--------	---------	---------

Additions to existing requirements are underlined and deletions are shown ~~lined out~~ below.

4	Info	General requirements
4.2	Info	Waste fitting openings, drainage, and overflows
4.2.2	Info	Overflows
<i>New clause added;</i>		
Bathtubs		
4.2.2.2		Overflows in bathtubs may be provided at the option of the manufacturer. When overflows are provided, their dimension, location, and position in relation to the waste outlet in the fixture shall be as shown in Figure 7.
5	Info	Test procedures
5.9	Info	Overflow test for sinks and lavatories
The overflow test shall be conducted as follows:		
5.9.1		a) Install the specimen using a waste fitting that complies with ASME A112.18.2/CSA B125.2. b) Supply water to the specimen <u>at a rate of 5.7 L/min (1.5 gpm) the maximum flow rate specified in ASME A112.18.1/CSA B125.1 for flow rate testing of a supply fitting appropriate for the specimen.</u> If the specimen is a laundry or utility sink, the rate of water supply to the major compartment shall be at least 15 L/min (4 gpm) and to the minor compartment (if any) at least 9 L/min (2.4 gpm).

Side view section B-B added;

Minimum dimensions for bathtubs

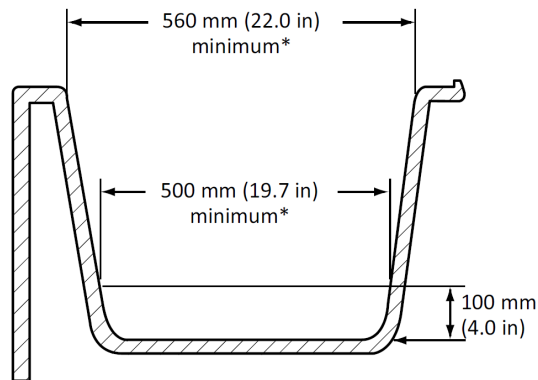

(c) Side view section B-B

Figure 7



CLAUSE	VERDICT	COMMENT
		CUSTOMERS PLEASE NOTE: This Table and column "Verdict" can be used in determining how your current or future production is or will be in compliance with new/revised requirements.